COMMON SUCCESS SIGNS USING EXTERMINEX™

Do note that success signs of colony elimination may sometimes vary from one site to another.

Exhibit	Observation
	• Dead termite soldiers observed inside the station or mud trails nearby. • This indicates that the termite colony has collapsed.
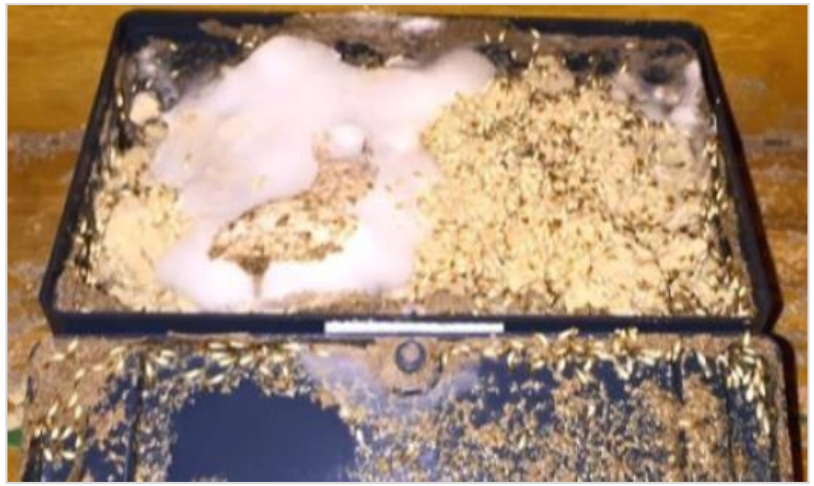	• Excessive growth of fungus on the bait. • This indicates that the worker termite population has crashed and there is a lack of worker termites for sanitary duty to maintain a clean environment.

COMMON SUCCESS OBSERVATIONS USING EXTERMINEX™

Do note that success signs of colony elimination may sometimes vary from one site to another.

Exhibit	Observation
	• No sign of live termites inside the station and mud trails nearby which include no termite 'clicking' sound.
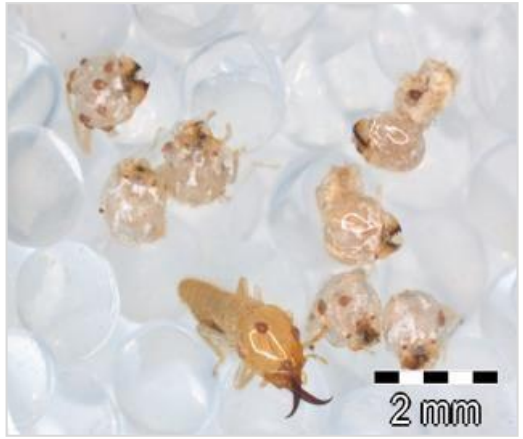	• Presence of termitophile (parasite) inside the station. • As the treatment approaches colony elimination, termitophiles emerge from underground and parasitically feed on weakened termites or readily decomposed materials.

AGGRESSIVE FEEDING PATTERNS OBSERVED USING EXTERMINEX™

EXTERMINEX™ BAIT PALATABILITY CONTRIBUTES TO AGGRESSIVE FEEDING

COMMON SIGNS OBSERVED USING EXTERMINEX™

MAJESTIC VIEW OF CARTON NEST INSIDE AG STATION

Exterminex™ is formulated from natural materials, termites get comfortable and are attracted to the bait

COMMON SIGNS OBSERVED USING EXTERMINEX™

PRESENCE OF ALATES

Indicates the colony has weakened and elimination is near.

COMMON SIGNS OBSERVED USING EXTERMINEX™

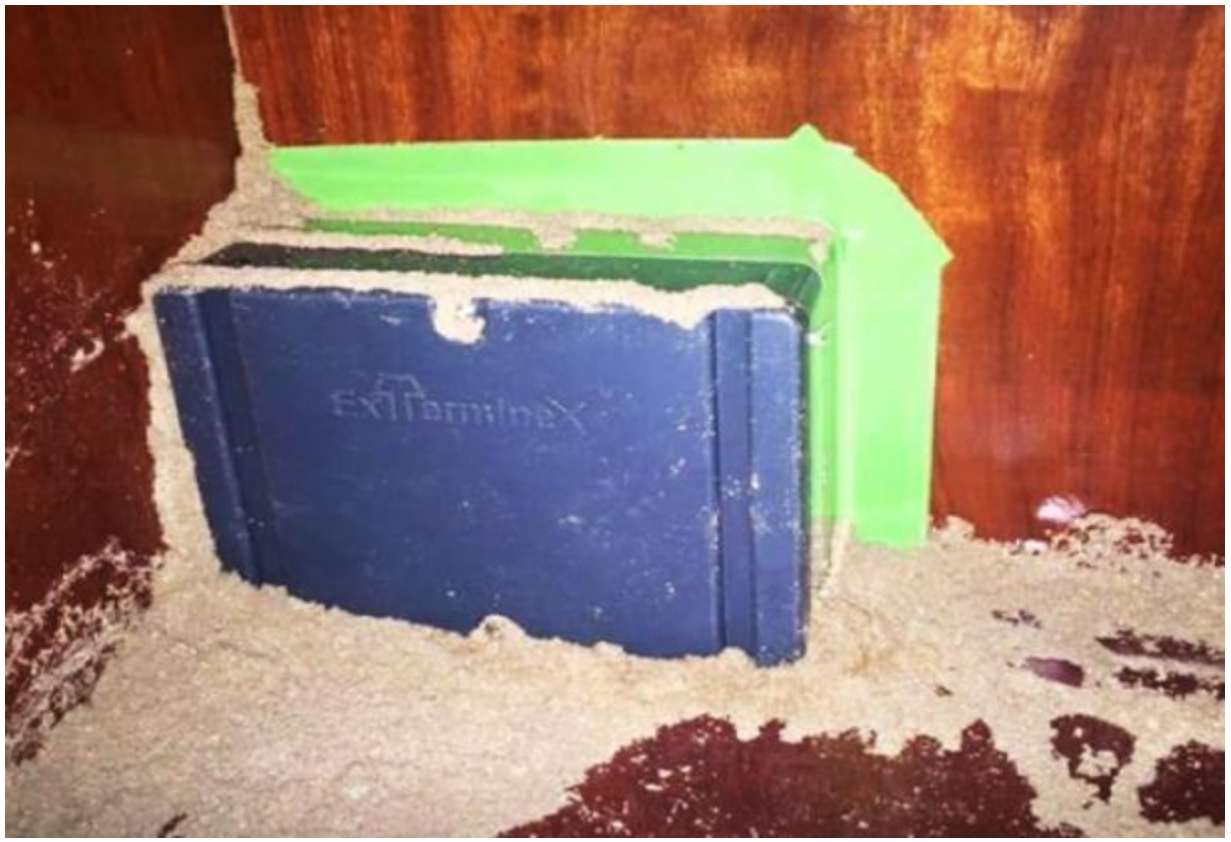

MUD SURROUNDING THE STATIONS

This indicates positive foraging towards the bait inside the station and shows that we have successfully diverted the termites attention from feeding on the structure to the bait instead.

FLOODING : What to expect during an unexpected event?

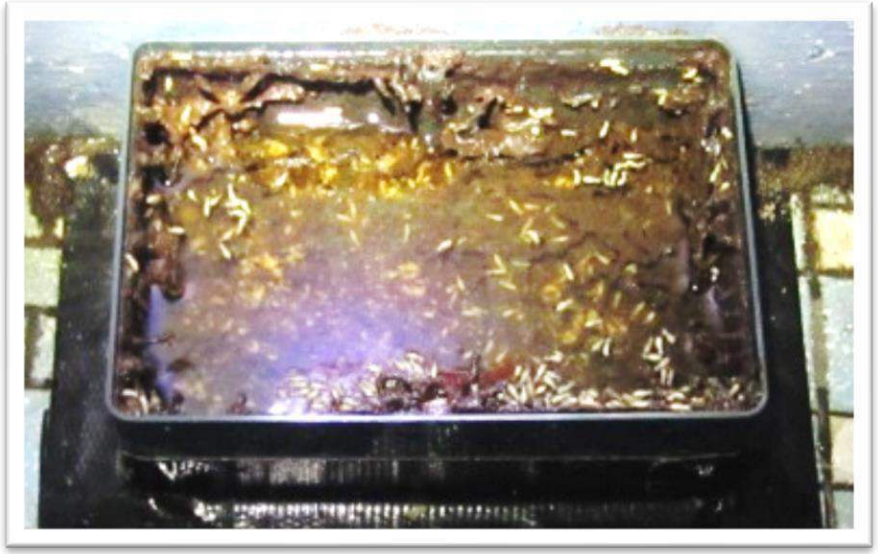

BEFORE

- *Flooded Exterminex™ Above Ground (AG) station with dead termites*
- *Observation Found :*
    1. *Mud trails still intact*
    2. *AG Station still in good condition*
- *Action: Re-installed bait station*

AFTER

- *Reproductive members of the termite colony found inside the station after weeks of re-installation.*
- *This indicates that the termite colony is still active and treatment should resume as normal.*